


MANAGEMENT OFFICE & RESTAURANT ROOM

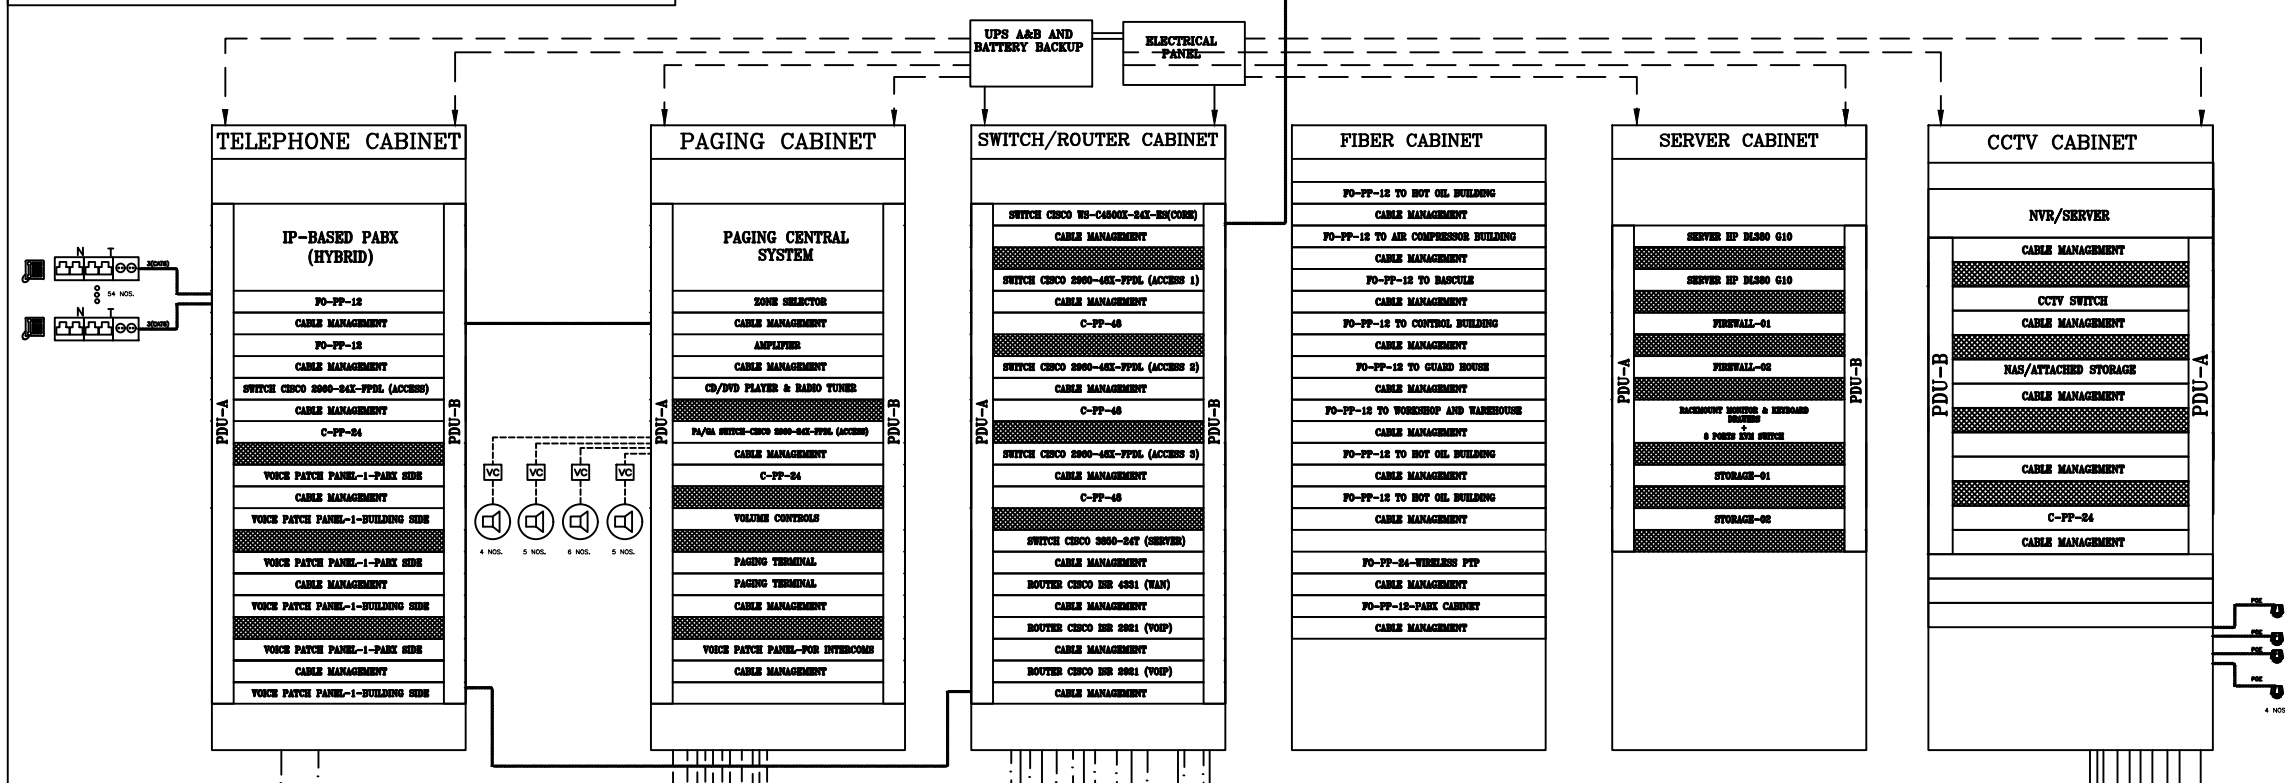

OUTDOOR JB
PST
(ON THE ROOF)

6XCAT6(SFTP, OUTDOOR TYPE)

GENERAL NOTES


- THIS IS A PRELIMINARY DRAWING AND SHALL BE DEVELOPED AND REVISED BY VENDOR.
- VENDOR/SUPPLIER SHALL CHECK ALL OF THE DRAWINGS AND DOCUMENTS BEFORE EXECUTION AND DECLARE ANY INCONSISTENCY.
- THE MULTI-PAIR CABLES SHALL INCLUDE 20% SPARE PAIRS
- FOR DISTANCE LESS THAN 100M, CAT6 CABLE CAN BE USED INSTEAD OF FOC.
- VENDOR SHALL SUPPLY ALL RELEVANT VOLTAGE CONVERTERS REQUIRED FOR THE TELEPHONE SYSTEM OPERATION.
- MORE DETAIL OF POWER DISTRIBUTION WILL BE SHOWN IN SLD FOR UPS.

LEGEND AND ABBREVIATION


REFERENCE DRAWINGS

REFERENCE DRAWINGS	DWG No.
PABX SYSTEM BLOCK DIAGRAM	BI103-EB-TC-BLD-0001
LAN/WAN SYSTEM BLOCK DIAGRAM	BI103-EB-TC-BLD-0003
CCTV SYSTEM BLOCK DIAGRAM	BI103-EB-TC-BLD-0004

KEY PLAN



REV.	DATE	Description	Prepared	Checked	Approved
BOO	27.FEB.2023	AFC	N.M.JAHROMI	F.REZAEI	N.SADRI
A00	22.FEB.2022	IFA	N.M.JAHROMI	F.REZAEI	N.SADRI

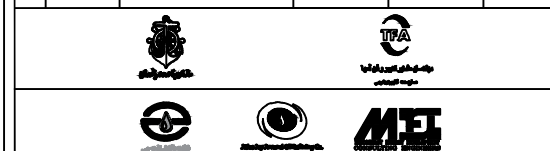

PROJECT TITLE:
BITUMEN PRODUCTION AND BITUMEN & HEAVY PETROLEUM PRODUCTS EXPORT (STORAGE) TERMINAL

DRAWING TITLE:
Telecommunication Overall Block Diagram

CONTRACT NO.: ۵۰۰/۱۳۰۰/۱۰۰۴

REF NO.:

DOCUMENT NO.: BI103-ED-TC-DIA-0001

PROJECT	PHASE	DISCIPLINE	DOC. TYPE	SERIAL	REVISION	SHEET NO.
BI103	ED	TC	DIA	0001	BOO	1 OF 1